

 **INTERACTIVE
MENU**
DCC RATINGS


**DCC
COMPARISON**


ISO DEFINITIONS


REQUIREMENTS


CONTACT US

BULLETIN 5600406 | TECHNICAL INFORMATION FROM CUMMINS

DATA CENTER CONTINUOUS RATINGS




 **FOR
A WORLD
THAT'S
ALWAYS ON™**

DATA CENTER CONTINUOUS (DCC) RATINGS: A COMPARISON OF DCC RATINGS, ISO DEFINITIONS AND UPTIME REQUIREMENTS.

While Uptime Institute references the ISO8528-1 definitions for generator ratings in their publication Tier Standard: Topology, they do not require the use of these definitions for generators to meet the Tier III and Tier IV requirements, as described in the same publication. A more cost-effective and reliable generator rating that meets the Tier III and Tier IV requirements can be achieved when the generator manufacturer develops ratings specifically for data center applications.

DIESEL GENERATORS IN A TIER III OR TIER IV SYSTEM

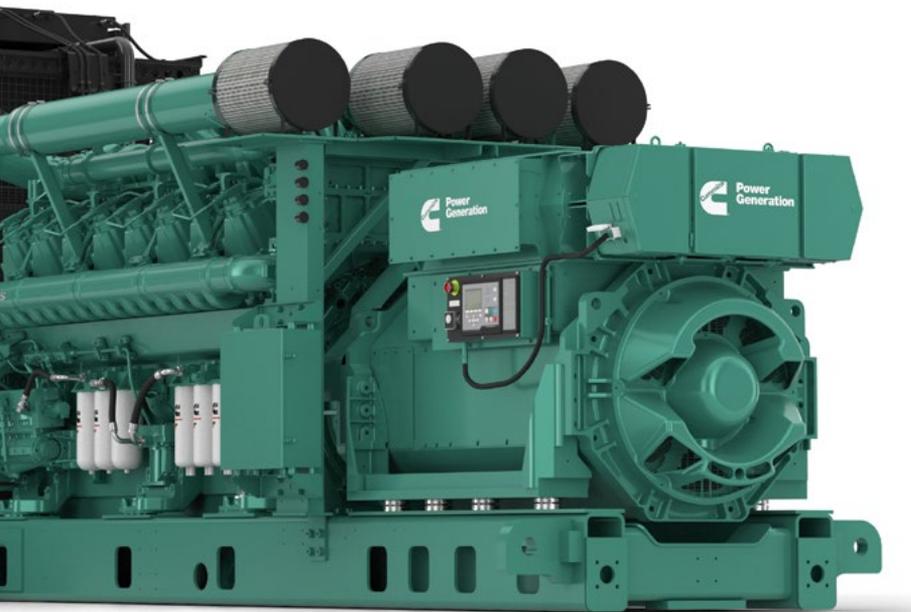

◀ **Figure 1** • Cummins QSK95-based generator sets offering ratings up to 3.5 MW based on ISO 8528-1.



FOLLOW US



@CumminsdeMexico

ISO 8528-1

In their Tier Standard: Topology publication, Uptime Institute references the Continuous (COP), Prime (PRP) and Standby (ESP) generator rating definitions of ISO8528-1. Of these ISO definitions, the only rating that meets Uptime Tier III or Tier IV at 100 percent of the generator rating is Continuous.

The ISO Prime rating definition states that the generator can run continuously if the average load does not exceed 70 percent of the full generator prime rating in any 24-hour period. The ISO Standby definition limits the run-time to no more than 200 hours per year, plus it limits the generator to no more than 70 percent average power during any 24-hour period.

See Figure 2 for a comparison table of the ISO8528-1 ratings.

ISO GENERATOR RATING	RUN-TIME LIMITATIONS	LOAD RATING
ISO Continuous (COP)	No limit on run-time at 100% of generator rating.	Rated for a constant load
ISO Prime (PRP)	No limit on run-time at 70% or less of generator rating.	Rated for a variable load
ISO Standby (ESP)	Allows no more than 200 hours of run-time per year	Rated for a variable load

▲ **Figure 2** • ISO 8528-1 definitions for Continuous, Prime and Standby power ratings.



FOLLOW US




@CumminsdeMexico

NO LIMIT ON RUN-TIME

The Tier Standard: Topology publication also states that the generator manufacturer's certification of capacity at an unlimited duration will be used to determine compliance with the applicable Tier requirements. This statement allows a generator manufacturer to design and rate a generator that more closely fits the needs of a data center and still meet the Tier III and Tier IV requirements. The Uptime Institute will also accept a site specific rating for a generator set.

In this scenario, the manufacturer submits a letter stating that there is no limit to run time for the generator set at a particular rating at a particular site. See a typical load profile of a data center in Figure 3. When the generator manufacturer provides a generator with no run-time limit that is sized closer to the site load and can still supply the maximum load spikes, the data center gets the most efficient use of their generator system.

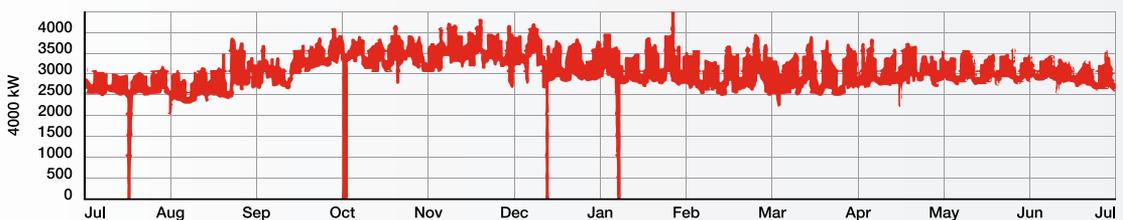

▲ **Figure 3** • Typical data center load profile.




FOLLOW US



@CumminsdeMexico

Some generator manufacturers start with the ISO Prime rating and reduce this rating by a certain percentage to achieve the no run-time limit requirement. Some manufacturers will provide a non-ISO defined rating that guarantees no run-time limit at 100 percent of that rating. These methods are discussed in section 3.3 of Uptime Institute’s Tier Standard: Topology publication. These unlimited duration ratings from the generator manufacturer will be used to determine compliance with Tier III and Tier IV requirements. Cummins has a complete line of high-horsepower generators with a Data Center Continuous (DCC) rating meeting these requirements. Detailed specification sheets are available for these generators in Cummins Power Generation’s online resource, Power Suite (powersuite.cummins.com).


The graph in Figure 4 compares a system with 2,500 kW DCC rated generators to a system with 2,500 kW ISO Prime (PRP) rated generators.

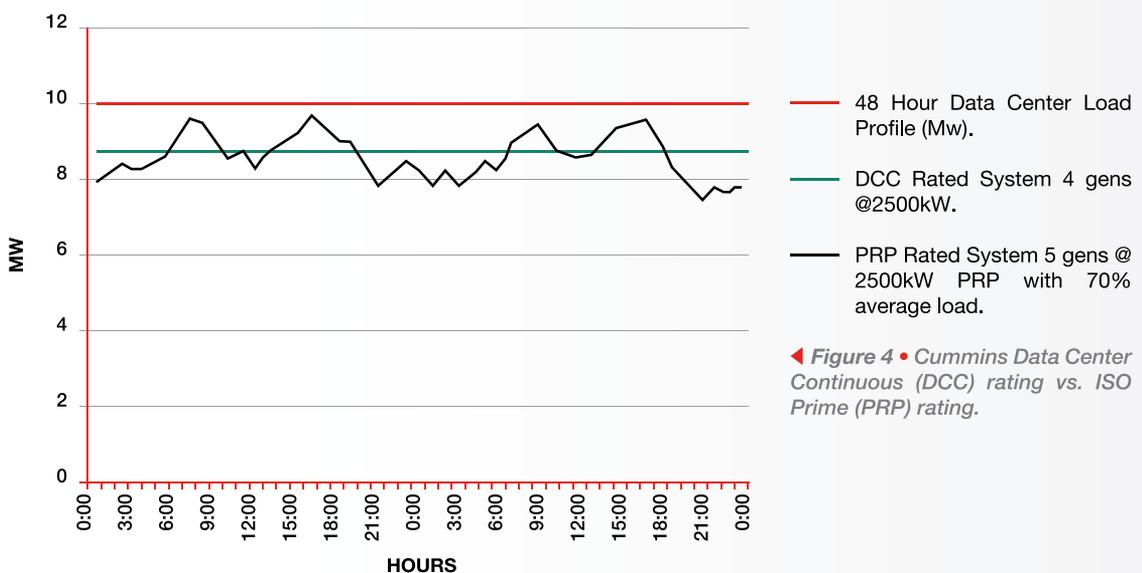

FOLLOW US



@CumminsdeMexico

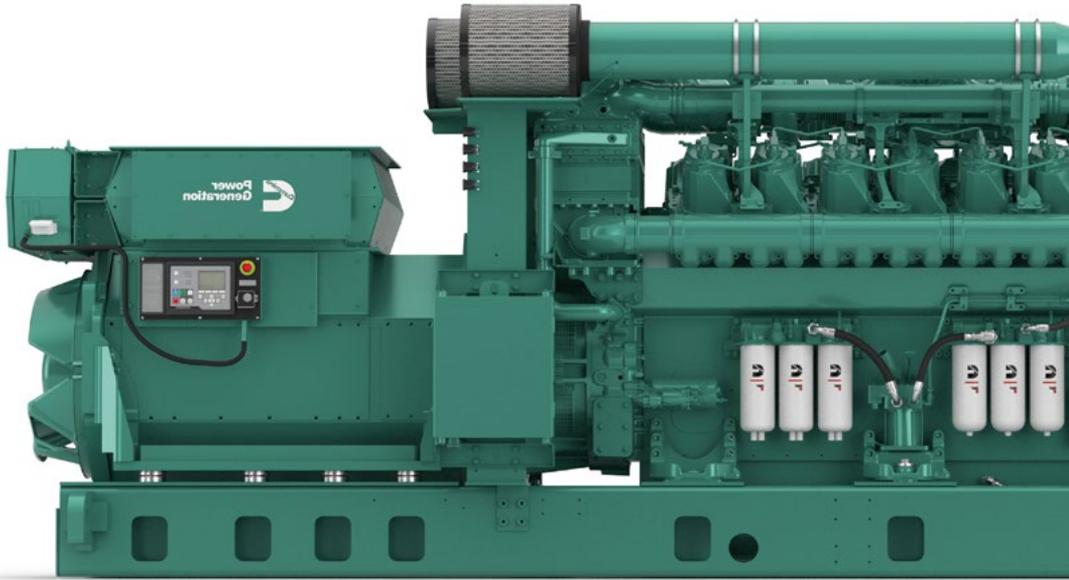

OVERSIZED GENERATORS

As stated before, an ISO Continuous (COP) rated generator does not meet the no run-time limit for Uptime Tier III and Tier IV. But a COP rated generator may not be the best fit for a typical data center load profile, nor does Uptime Institute require generators to be ISO COP rated. There are optimum load levels for running diesel generators. One rule of thumb for optimum engine life is that the generator engine should be run greater than 30 percent of its maximum horsepower rating. This ensures that the exhaust temperature will be high enough to burn up the majority of particulate in the exhaust. Incomplete combustion at low loads can cause increased valve wear and degradation in the turbochargers, both of which increase maintenance needs and decrease reliability.




FOLLOW US



@CumminsdeMexico

In Figure 5, we compare a system utilizing five 1.6 megawatt COP rated generators to a system utilizing five 1.6 megawatt DCC rated generators. The load shown is about 36 to 39 percent of the generator system's 100 percent rating.

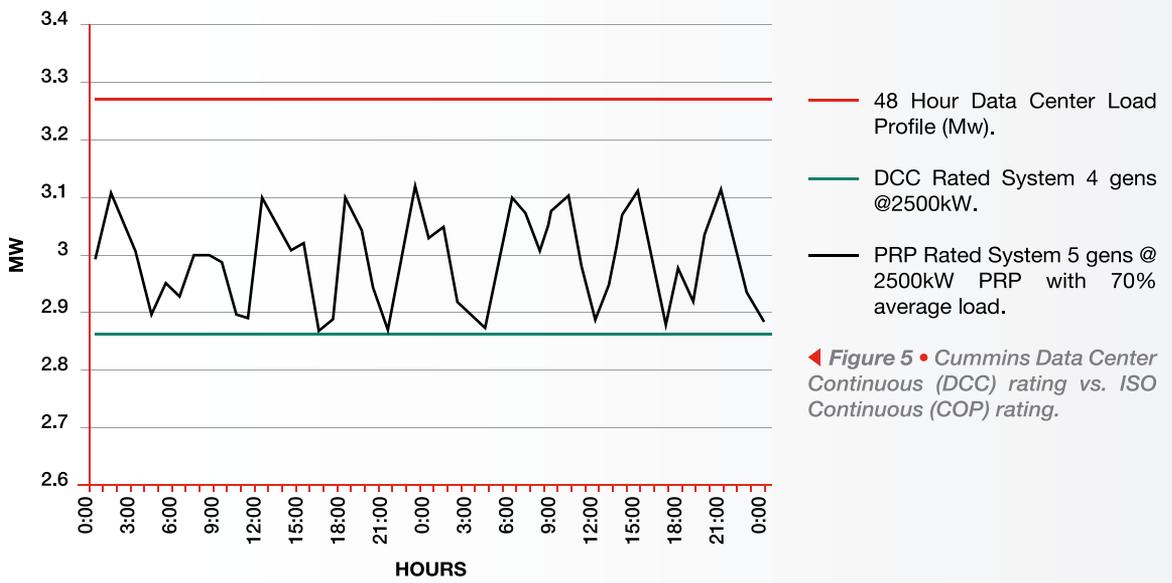

This light load is very common in real-world data centers. As the graph shows, the COP rated generators are running below 30 percent of their maximum horsepower, while the DCC rated generators are running above 30 percent of their maximum horsepower. The DCC rated generator system is the more reliable choice in this example, and it will operate closer to the optimum horsepower of the engines, reducing the risk of low load failures.




FOLLOW US



@CumminsdeMexico

CHOOSE THE MOST EFFICIENT GENERATOR FOR YOUR DATA CENTER

To summarize, it is best to choose generators that most closely fit the load profile of your data center and still meet the Uptime Tier III and Tier IV standards. This will provide the most value. Plus, the generators will run closer to their optimum load level, which will increase the life and reliability of the generators.

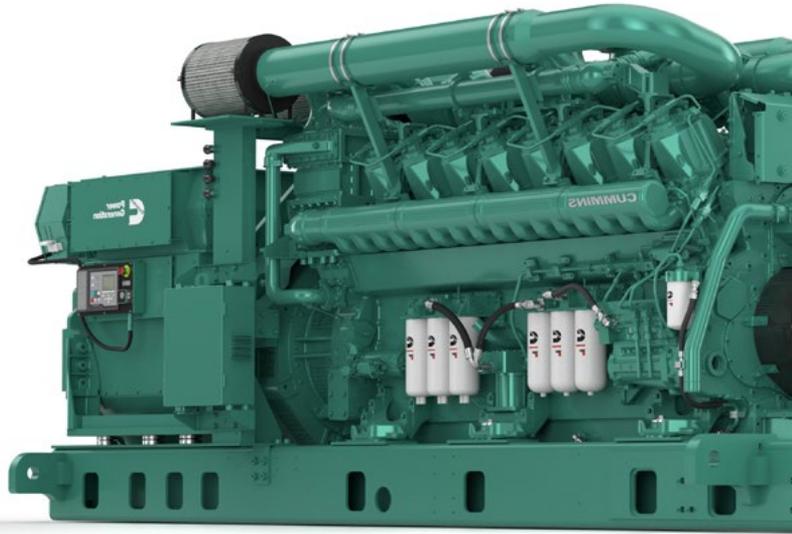

[Distribuidores Cummins](#)



[Sitios Web](#)



[Video Data Center](#)



Las imágenes que se muestran en esta ficha técnica son de carácter informativo y las especificaciones de los productos son de carácter informativo y de referencia, las cuales pueden cambiar sin previo aviso. Le pedimos acudir con su Distribuidor Autorizado Cummins más cercano para obtener información.

©2022 Cummins Inc., Impreso en México.



FOLLOW US



@CumminsdeMexico